

# PARTICLE SIZE DISTRIBUTION TEST


BS EN 933-1. 1997

By Washing and Sieving

Sample Number: 1

Classification Type: 40/80mm

40/80mm

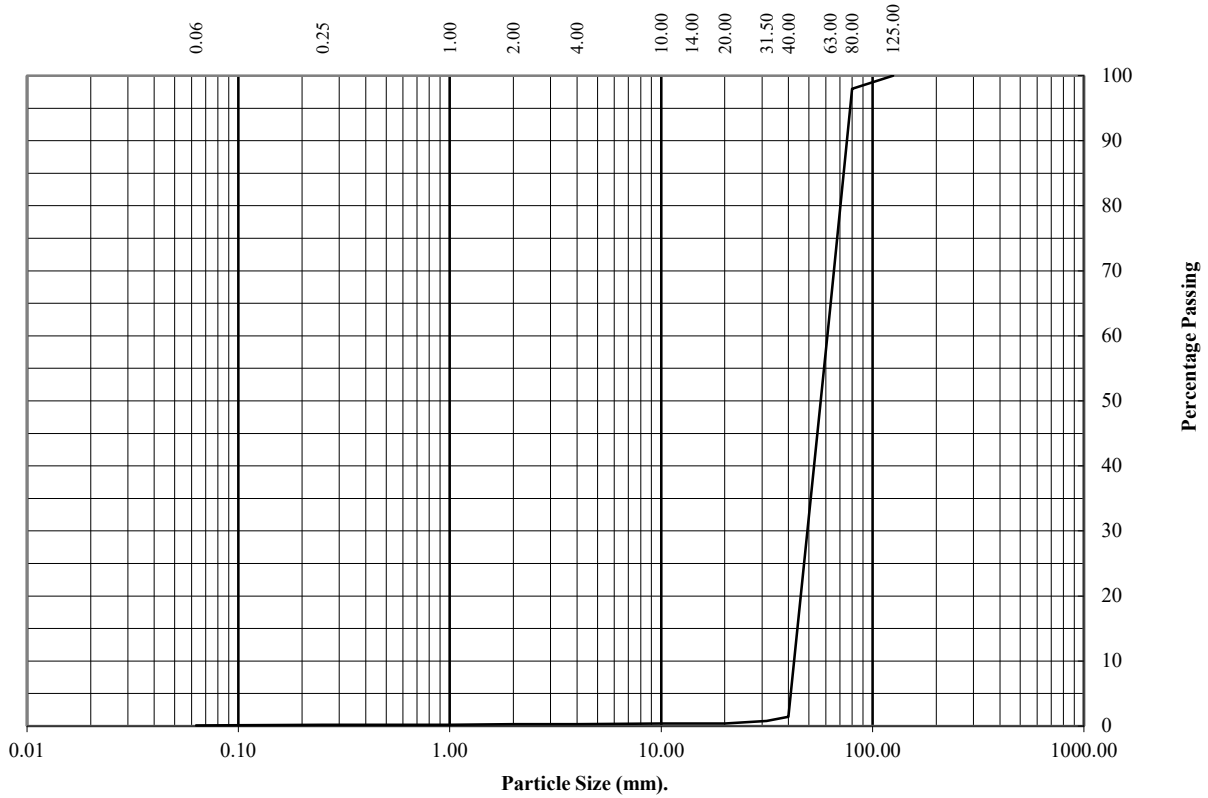

| BS Test Sieve mm | Percentage Passing % | 40/80mm |       |
|------------------|----------------------|---------|-------|
|                  |                      | Lower   | Upper |
| 125              | 100                  | 98      | 100   |
| 80               | 98                   | 80      | 99    |
| 63               | 64                   | 20      | 70    |
| 40               | 1                    | 0       | 20    |
| 31.5             | 1                    |         |       |
| 20               | 0                    | 0       | 5     |
| 14               | 0                    |         |       |
| 10               | 0                    |         |       |
| 4                | 0                    |         |       |
| 2                | 0                    |         |       |
| 1                | 0                    |         |       |
| 0.25             | 0                    |         |       |
| 0.063            | 0                    |         |       |

Remarks:



Port Salford

Contract No:

PSL23/5089

Client Ref No:

L